


## EXAMPLES OF ALERT NOTIFICATION


### Sample alert messages

- include site name and alert type
- include sensor readings at time of alert with alarm threshold values for further analysis

### Long format to an email address

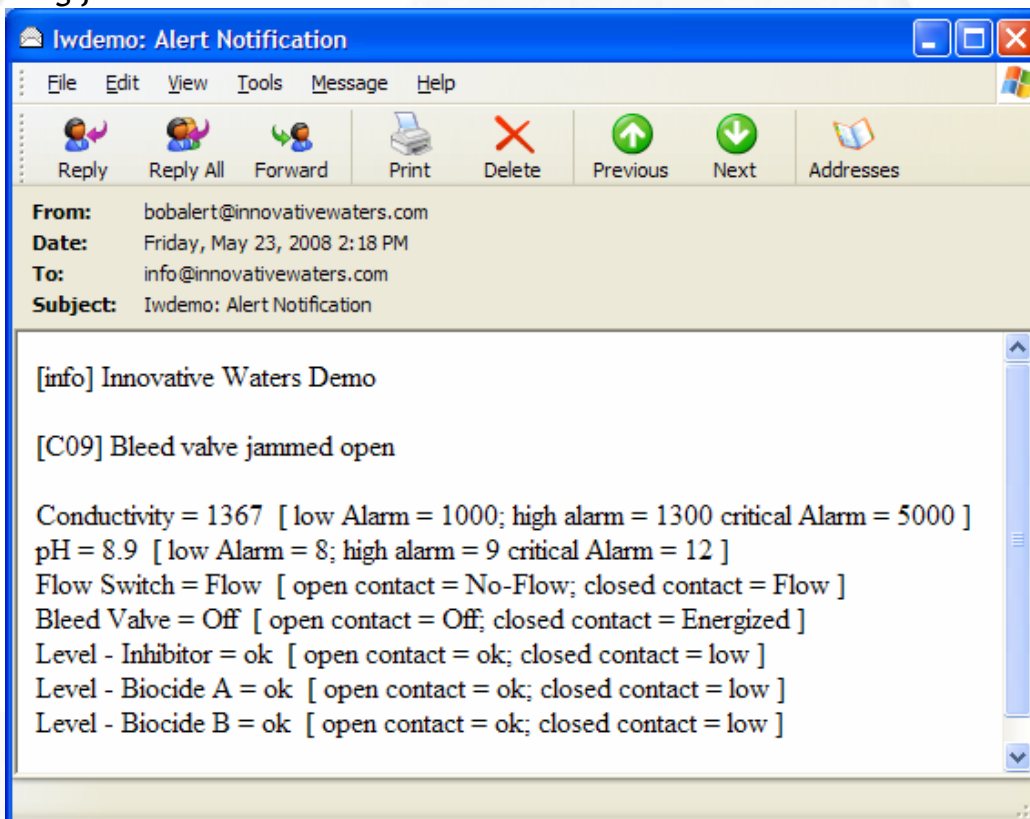


### Short format to a cell phone/PDA

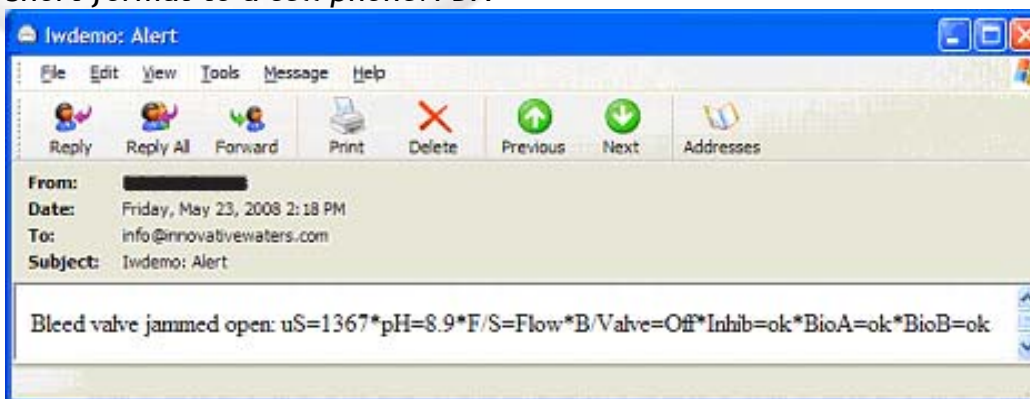

## Sample system update messages

- include site name as well as readings & alarm threshold values at time of update

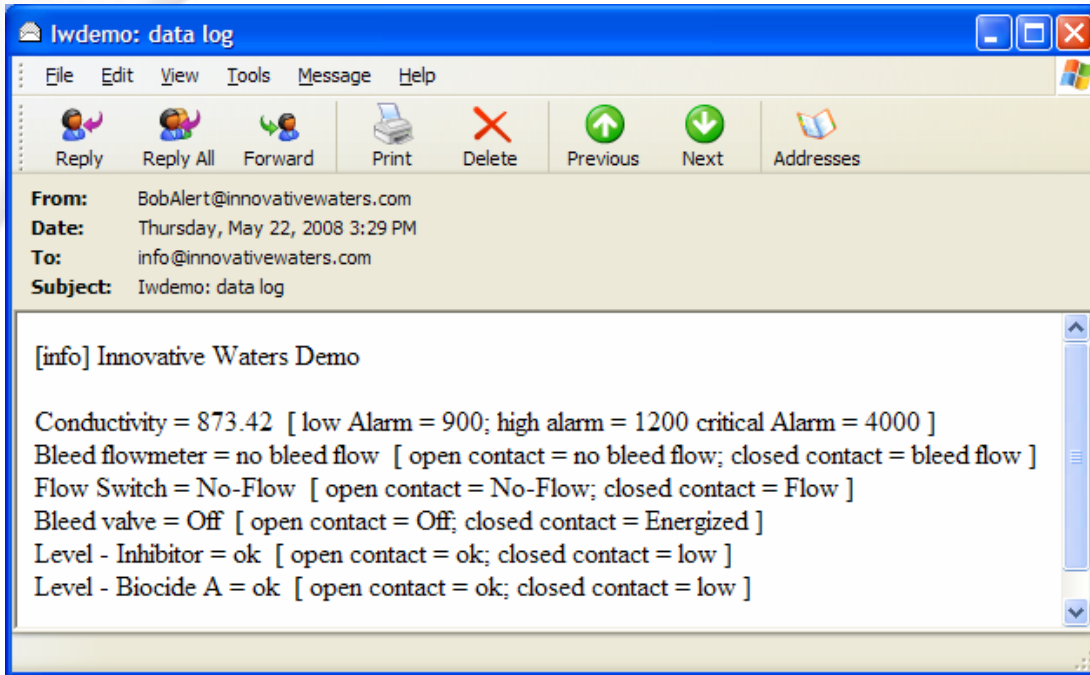

## Sample eventlog reports

- Emailed automatically in Excel format at regular intervals (weekly, monthly, etc.)
- include all data transmissions: system updates, alarms, status inquiries, etc.]

Date	Notification Message	Conductivity	pH	Level - Inhibitor	Level - Biocide	Flow Switch	Bleed valve	Sump level
9/14/2008 12:00:44 PM	Instant Log	1198	8.8	26.60	14.27	Flow	Off	Level - ok
9/15/2008 12:01:14 PM	Instant Log	1232	8.7	26.20	14.27	Flow	Energized	Level - ok
9/16/2008 12:01:40 PM	Instant Log	1180	8.7	25.63	13.36	Flow	Off	Level - ok
9/17/2008 12:01:22 PM	Instant Log	1195	8.7	24.94	13.36	Flow	Off	Level - ok
9/17/2008 5:34:59 PM	Status request	na	na	na	na	na	na	na
9/17/2008 5:35:40 PM	Instant Log	1241	9.0	24.54	12.42	Flow	Energized	Level - ok
9/18/2008 12:01:44 PM	Instant Log	1192	8.8	24.07	12.42	Flow	Off	Level - ok
9/19/2008 10:37:44 AM	Bleed valve problem	2040	8.7	23.29	12.42	Flow	Energized	Level - ok
9/19/2008 12:00:14 PM	Instant Log	1320	8.9	23.22	12.42	Flow	Energized	Level - ok
9/19/2008 1:03:29 PM	Power Restored	na	na	na	na	na	na	na
9/20/2008 12:00:29 PM	Instant Log	1193	8.8	22.50	11.52	Flow	Off	Level - ok
9/21/2008 12:00:29 PM	Instant Log	1221	8.7	22.30	11.52	Flow	Energized	Level - ok
	Low Alarm	1000	8.0	3.0	3.0		na	na
	High Alarm	2000	9.3	na	na		na	na
	High-high Alarm	9999	na	na	na		na	na
	Open contact					No-Flow	Off	Level - low
	Closed contact					Flow	Energized	Level - ok